


**UNDERGROUND UTILITIES**  
 CALL  
**2 WORKING DAYS**  
**BEFORE YOU DIG**  
 CALL TOLL FREE 800-362-2764  
 OHIO UTILITIES PROTECTION SERVICE

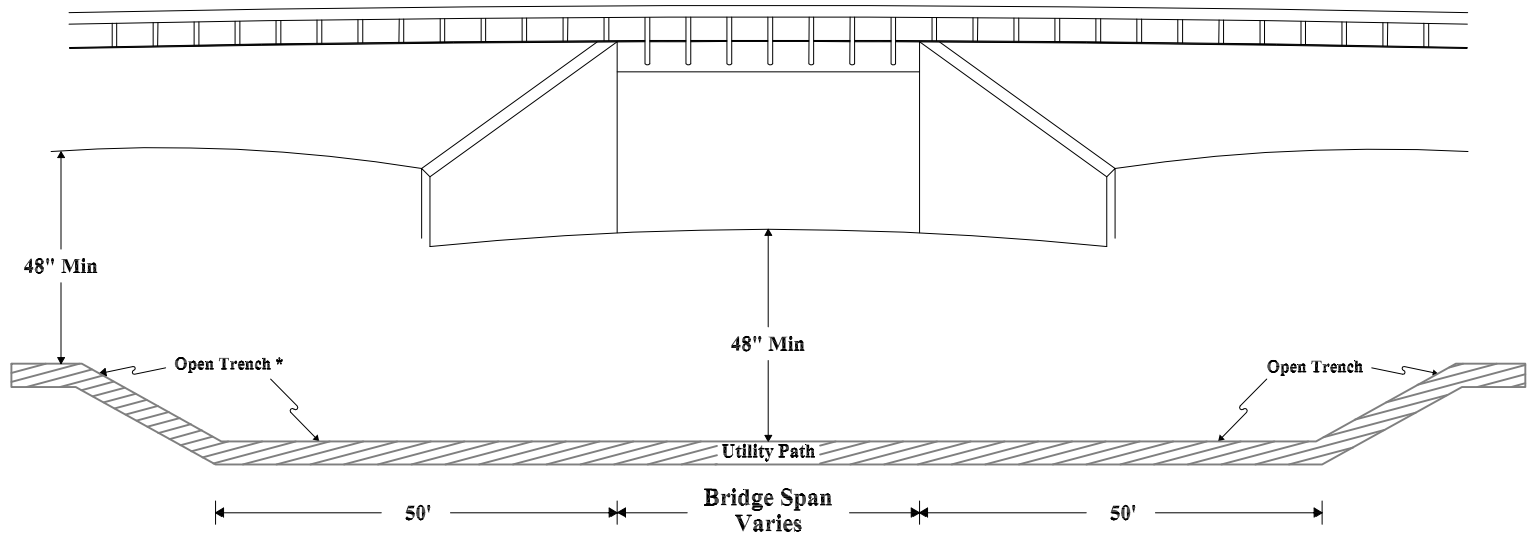

\* Trench should have a minimum width of 12"

**\*\*In the event during excavation that any agricultural tile(s) or other subsurface drainage tile(s) are damaged, these tile(s) shall be replaced with the same size N-12 plastic or similar approved material, including all couplings.**

**\*\*Pickaway County Engineer Inspector shall be contacted to view open trench prior placement of any backfill by the contractor.**

**\*\*Trench below tile must be backfilled and compacted in 6" lifts.**

## Minimum Standards for Utilities Crossing Waterways at Bridges

Pickaway County Engineer

Dep. Pickaway County Engineer

Approved:

**1-23-07**

Revised

**Minimum Standards for Utilities Crossing Waterways at Bridges**

